



Lot #1

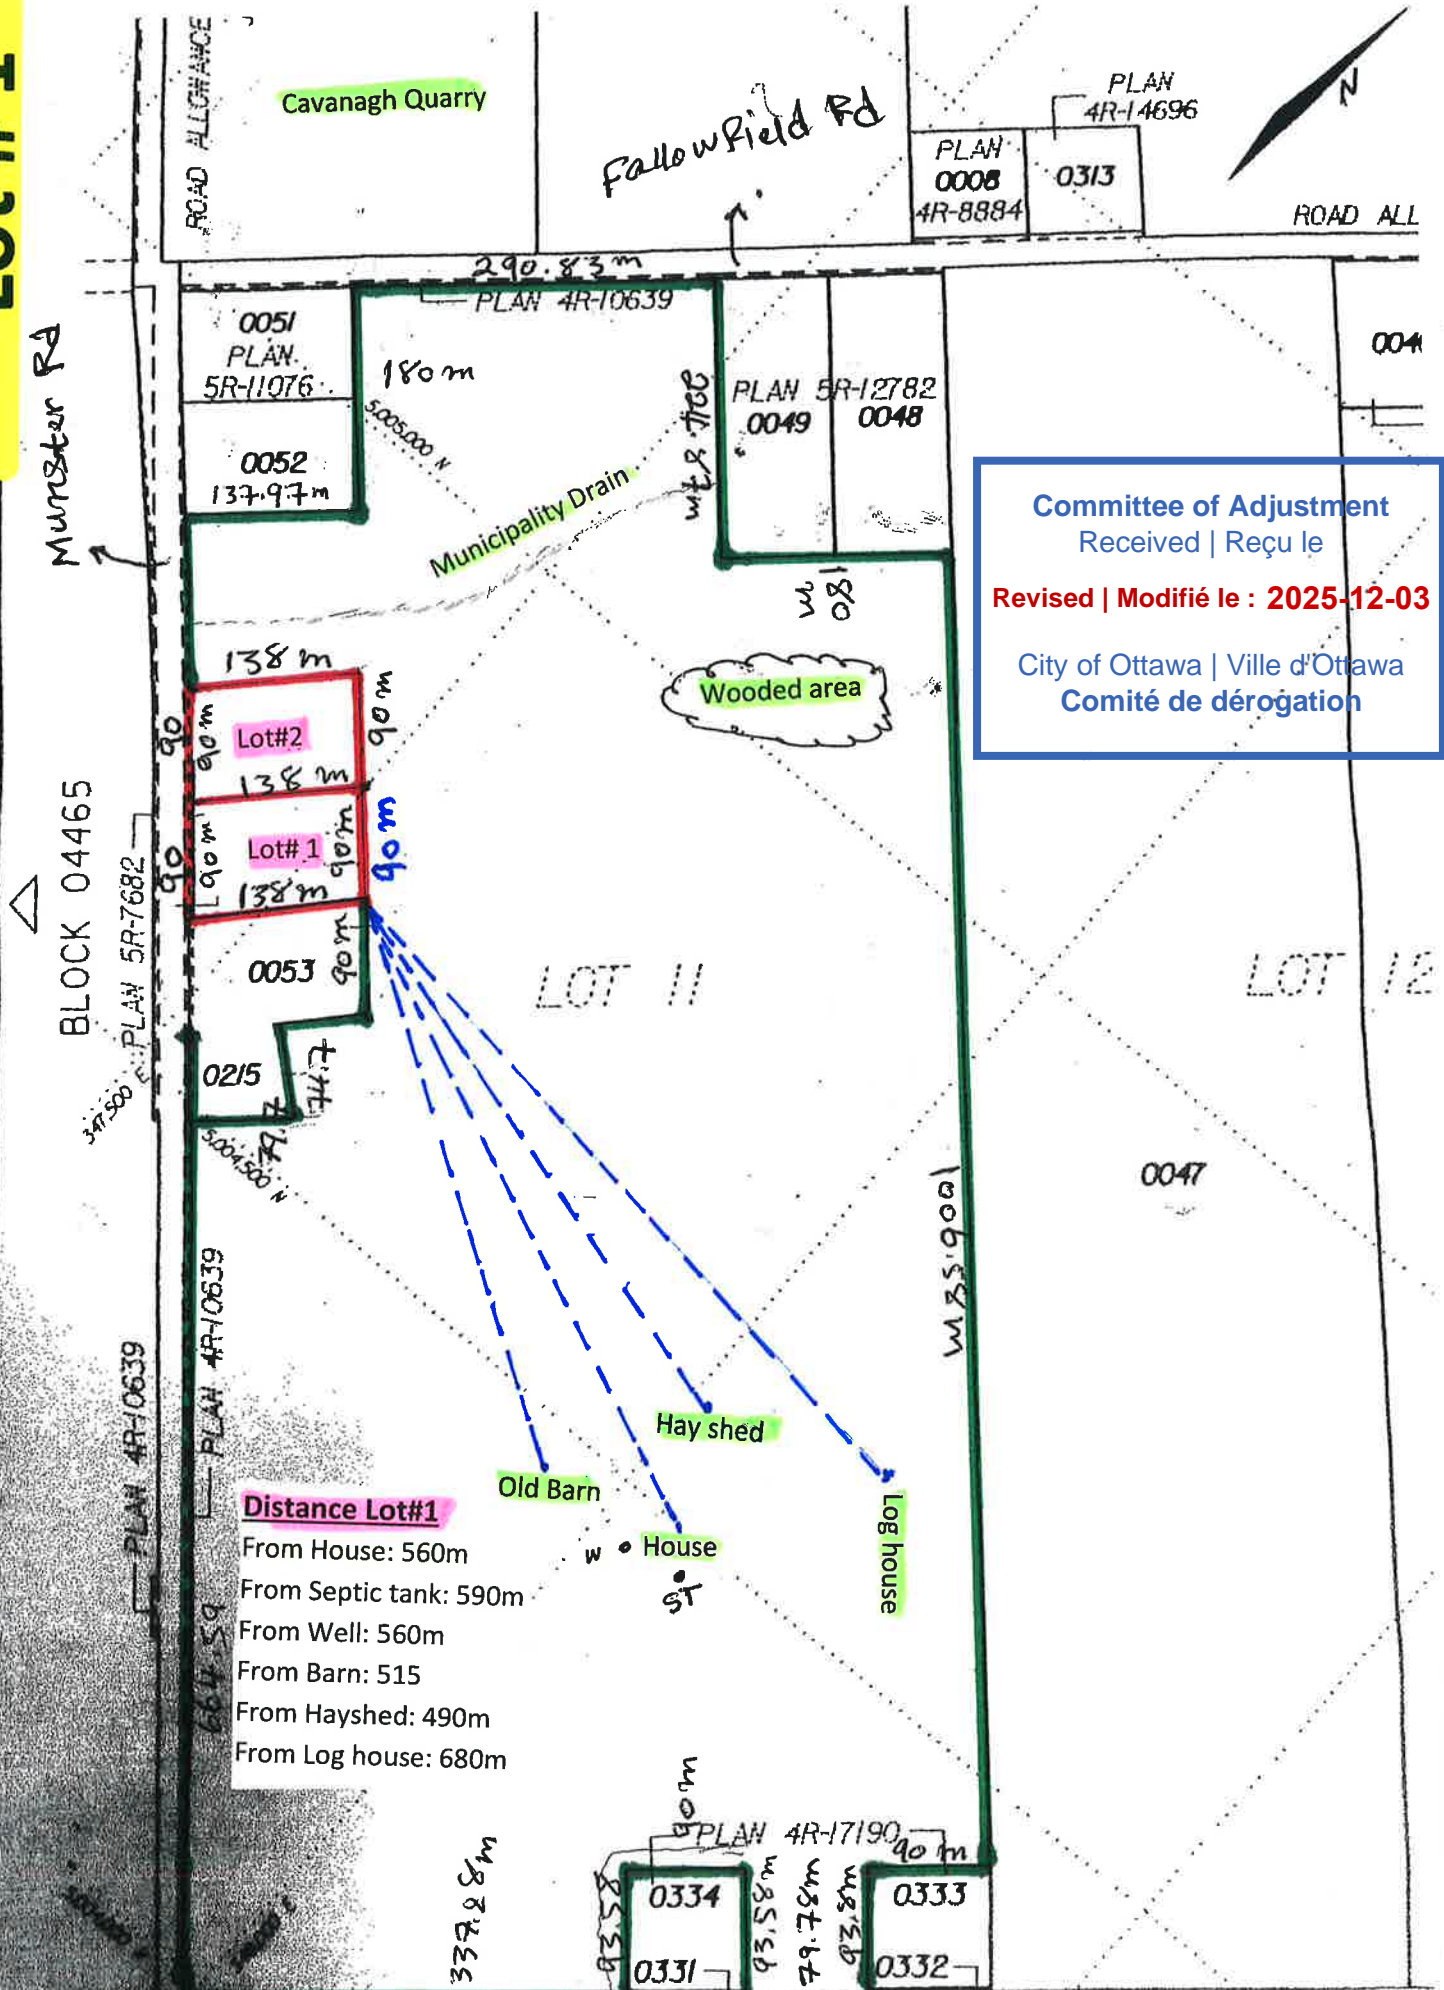

Committee of Adjustment
 Received | Reçu le
 Revised | Modifié le : 2025-12-03
 City of Ottawa | Ville d'Ottawa
 Comité de dérogation

Lot # 2

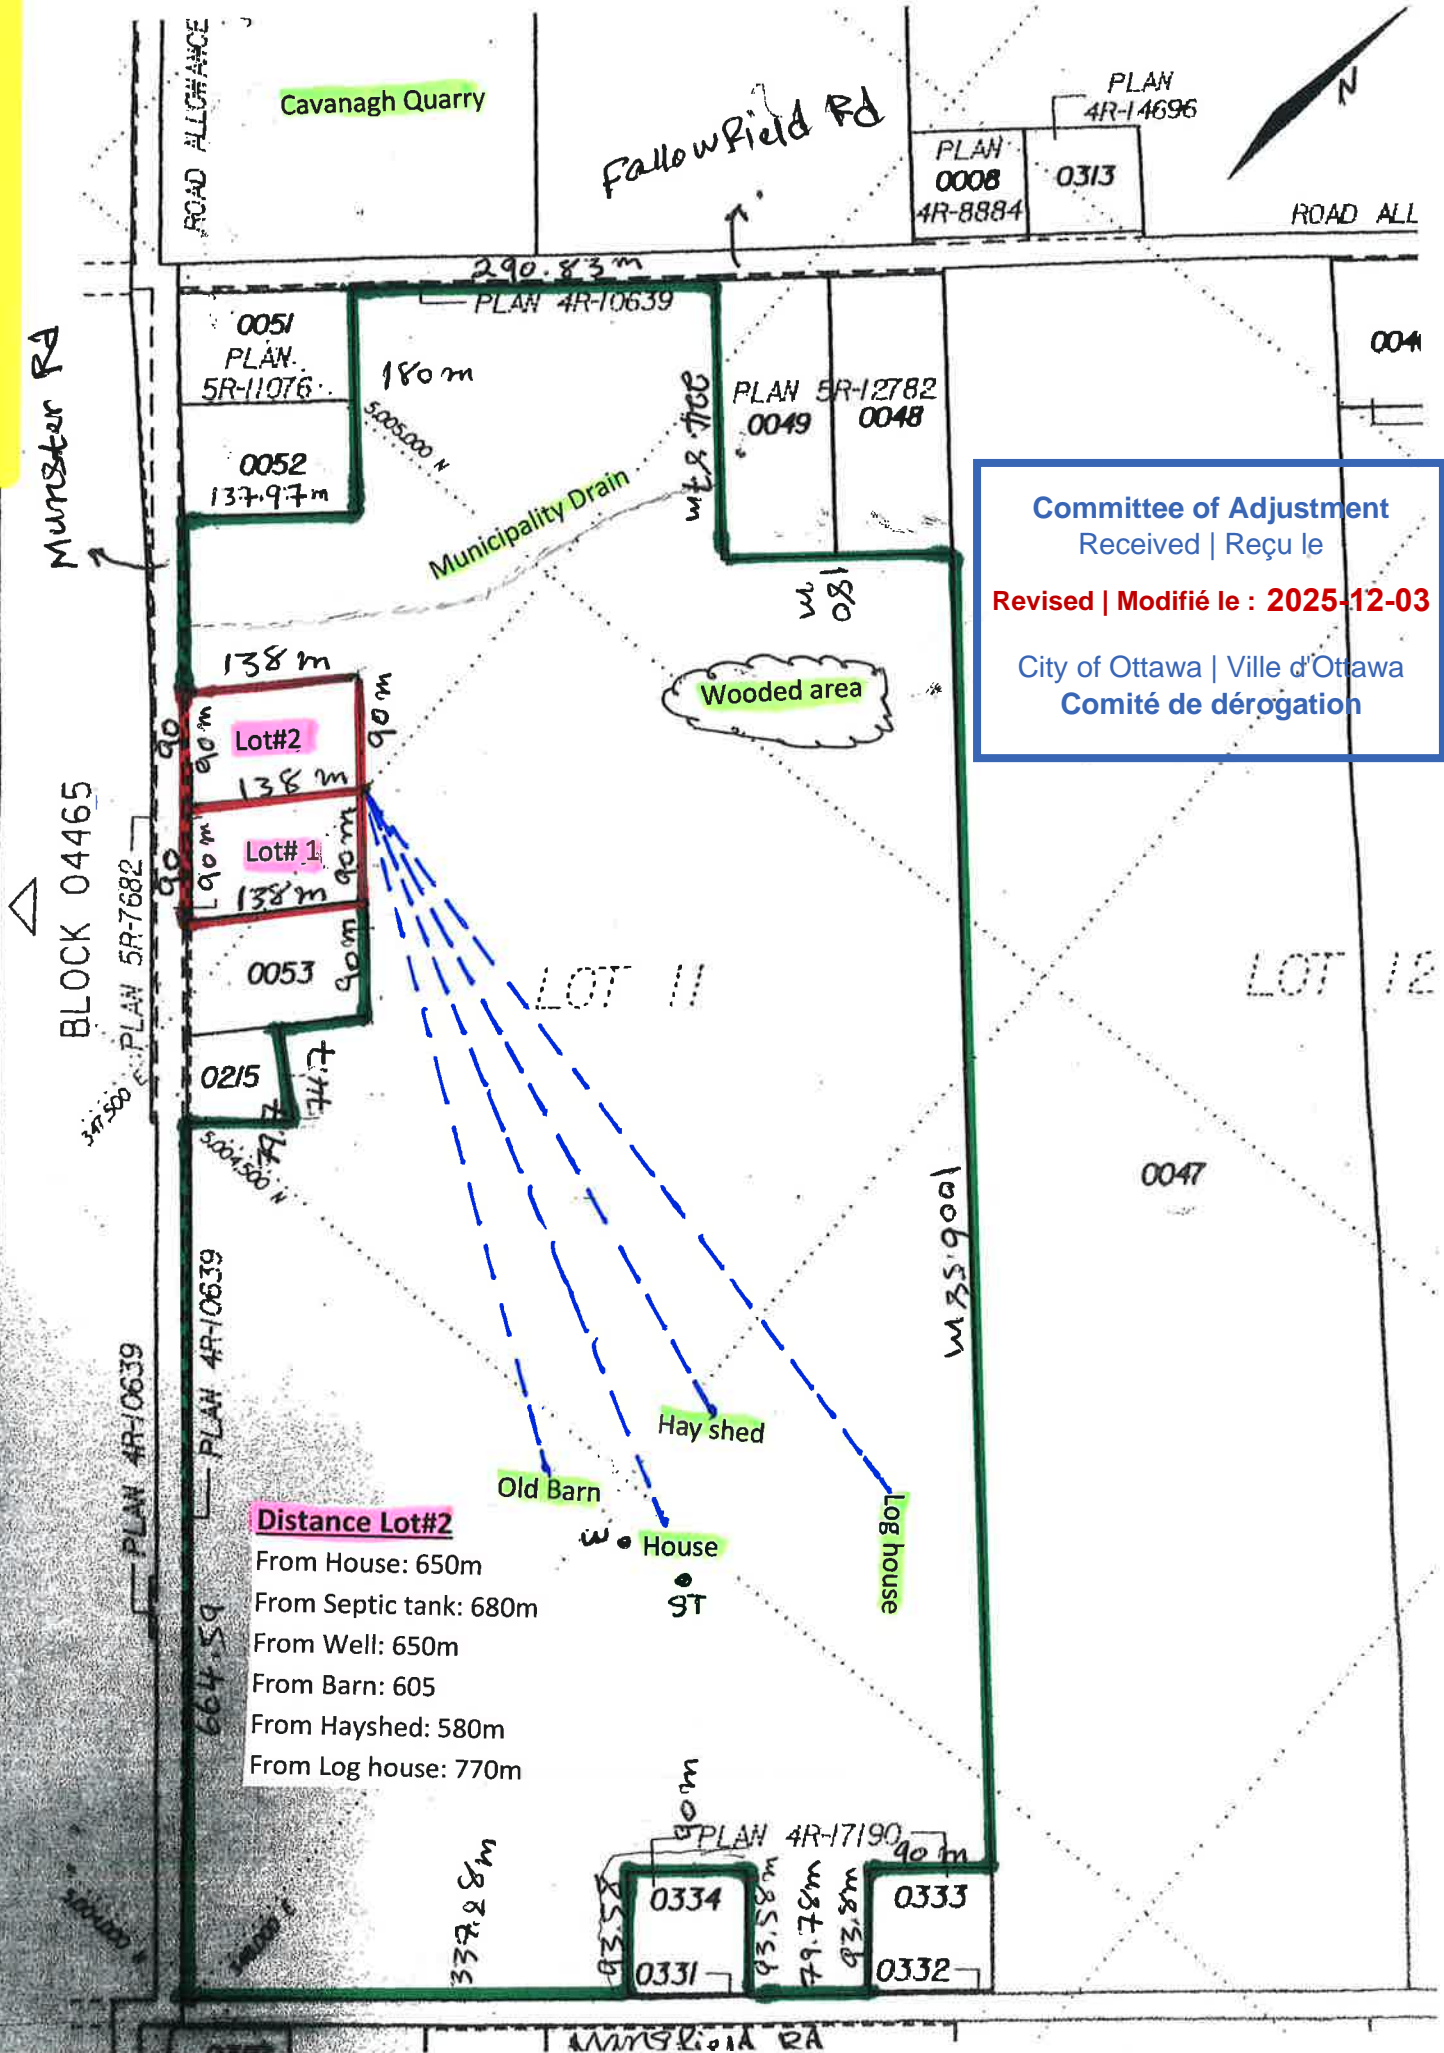

Committee of Adjustment
 Received | Reçu le
 Revised | Modifié le : 2025-12-03
 City of Ottawa | Ville d'Ottawa
 Comité de dérogation

Distance Lot#2
 From House: 650m
 From Septic tank: 680m
 From Well: 650m
 From Barn: 605
 From Hayshed: 580m
 From Log house: 770m